



Connection: Adder Input Options SI239

All inputs are referenced to the common of SI239, must be 4-20mA independently sourced signals. Use a signal powered isolator SPI232 if isolation is required.


OPTION 61: Dual INPUT ADDER

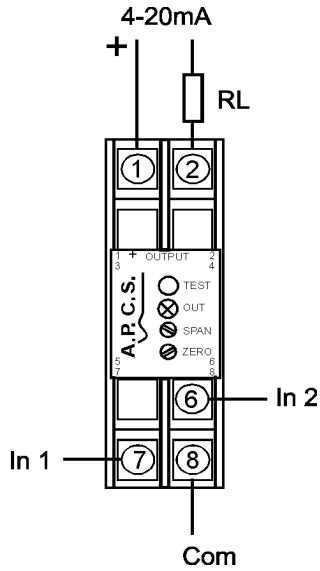

OPTION 67: QUAD INPUT ADDER

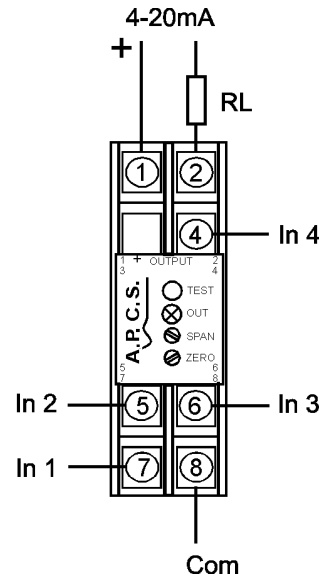

OPTION 66: TRIPLE INPUT ADDER

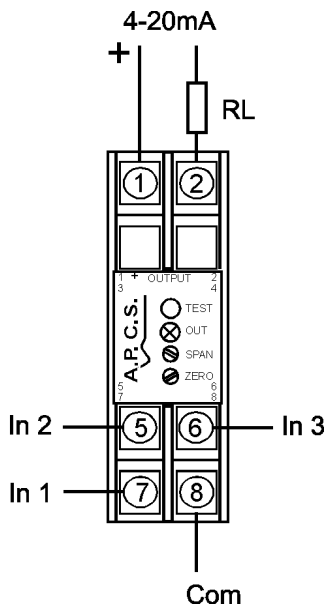

In the interest of development and improvement, APCS reserve the right to amend, without notice, details contained in this publication. APCS will accept no legal liability for any errors, omissions or amendments.